


Δp - Regler - Regulator - Régulateur DPQ*

Wiring diagram:

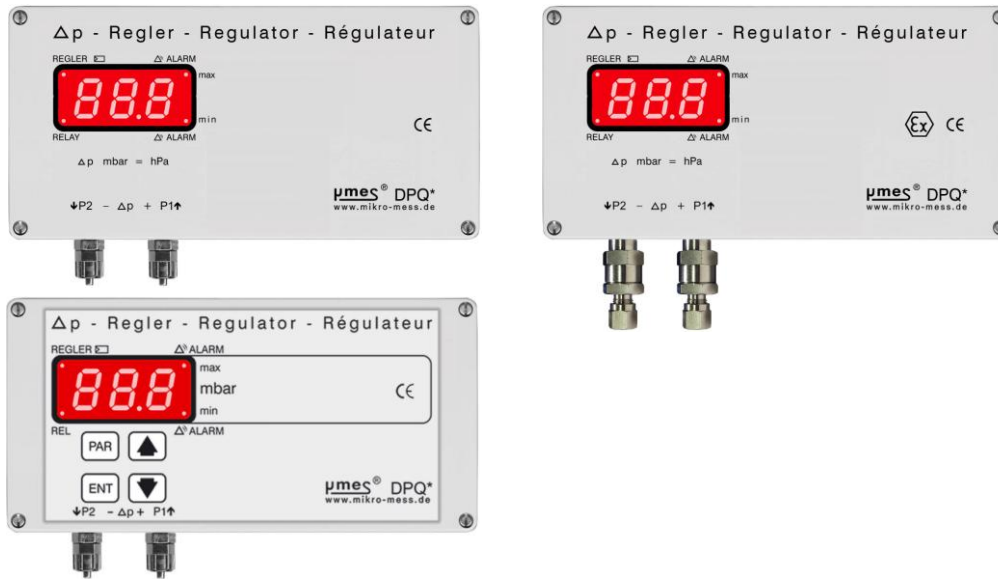

1. Wiring diagram:

Supply DC
24 V, 3.3 W

REGULATOR max. 2A
ALARM max. 2A

Earth-connections in the case of device for ATEX zones:

1. In housing
2. In lid
3. Outside housing.



Jumper programming analogue output at terminal 14+/11-

The jumper is located to the left of the digital display below on the mainboard of the device

Analogue output
mA / V

HOLD RELAY (Opt.)
INPUT max. 2A

ALARM
min

L supply N
120/240V, 50-60Hz, 5VA

120V: Bridge 1+3
and 2+4
240V: Bridge 2+3

Use only **one** power supply DC (terminal 11+12) or AC (terminal 1+4).

1.1. Supply voltage / signal output:

The nominal supply voltage and the admissible tolerance as well as the admissible load/burden for the analogue output and the admissible applied load of the switching outputs is stated in the data sheet.